






Notes:


1. All dimensions shown in millimetres (mm) unless stated otherwise.
2. Trench details are intended for planning purposes only.
3. Spacing between all cables to be confirmed through electrical contractor.
4. Do not scale from this drawing.
5. Where additional power cables are required, the trench makeup remains the same following indicative spacing and backfill material.

Legend:

-  Existing Ground
-  Backfill
-  Concrete surround
-  Sand Surround

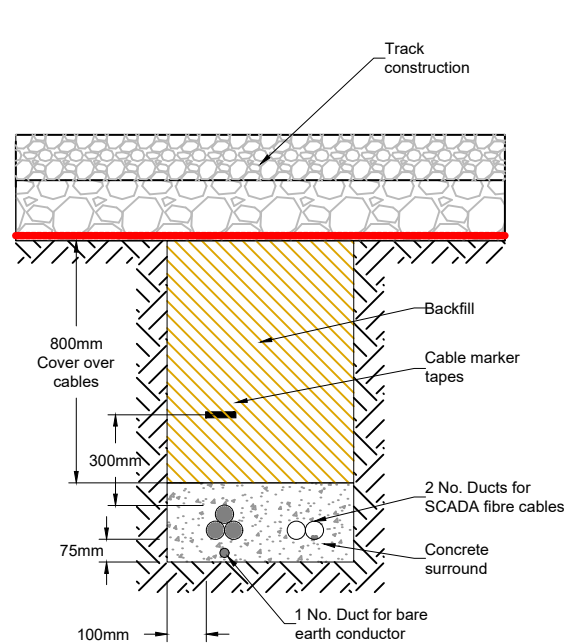


HV Single circuit

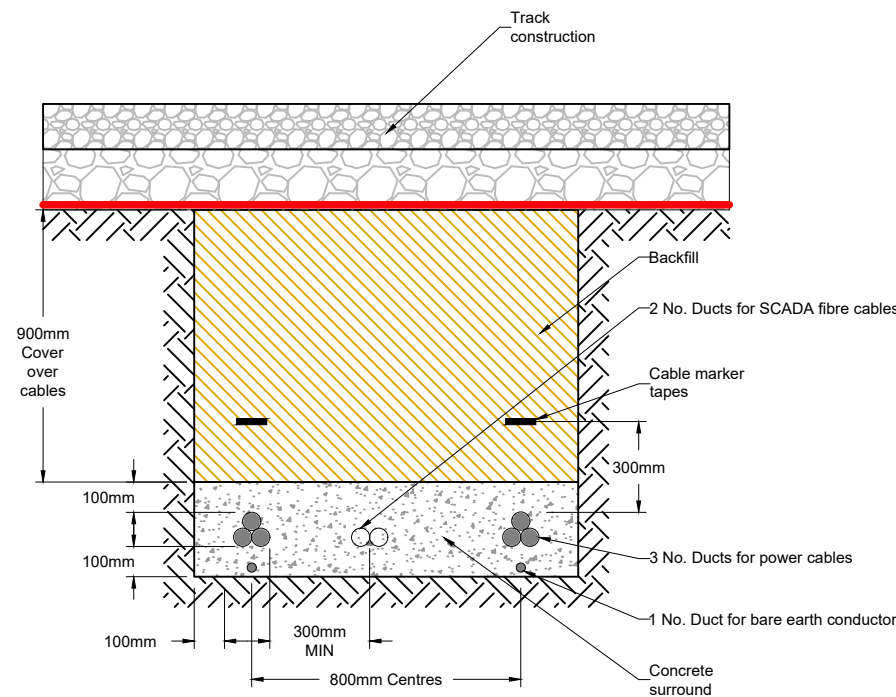


HV Double circuit

Section through track crossing typical cable trench

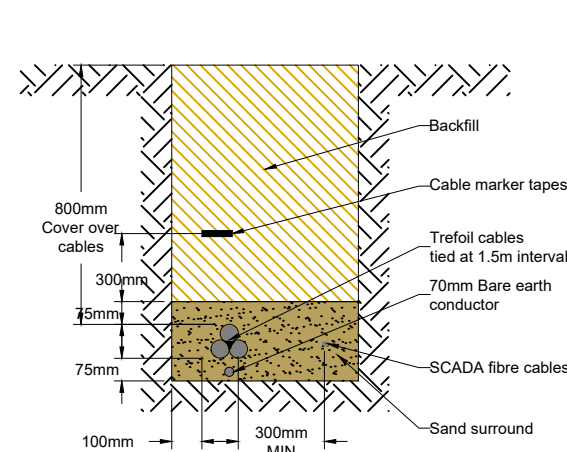

HV Single circuit

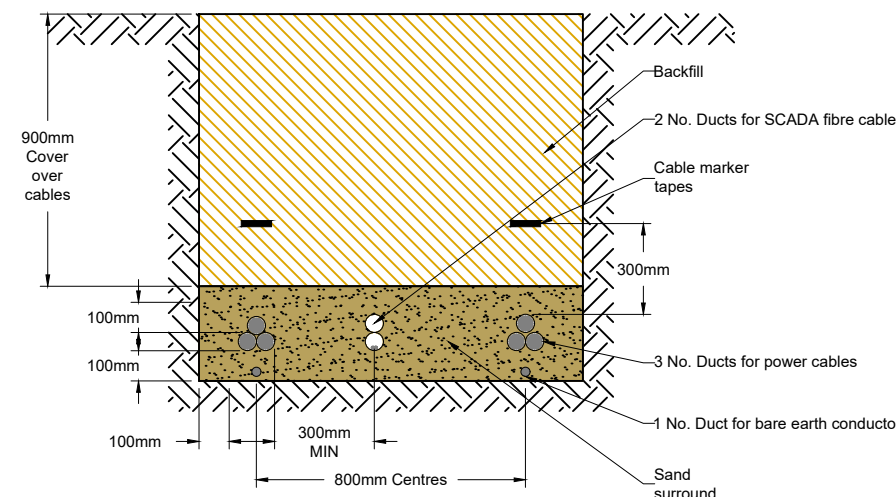

HV Double circuit

Section through typical cable trench

P02	Client comments	04/26	SJB	RA	GH
P01	Initial Issue	12/25	IG	RA	GH
Rev	Amendments	Date	By	Chk	Auth



www.slrconsulting.com

Client
RWE Renewables Ireland

Project
Muingmore Wind Farm

Figure Title
Typical Cable Trench Details

Scale 1:25	@ A3	SLR Project No. 501.065301.00001
Designed N/A	Drawn IG	Checked RA
Date N/A	Date 12/25	Date 04/26
Figure Number D20	Rev. P02	



Scale 1:25